



UL INTERNATIONAL (UK) LTD  
 Kingsland Business Park,  
 Unit 1-3 Horizon,  
 Wade Rd,  
 Basingstoke RG24 8AH,  
 United Kingdom



designated according to Article 29 of the Regulation (EU) No 305/2011 and member of EOTA (European Organisation for Technical Assessment, [www.eota.eu](http://www.eota.eu))

## European Technical Assessment

## ETA 19/0749 of 20/11/2019

**Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011:** **UL International (UK) Ltd**

**Trade name of the construction product**

Hensotherm Kitt

**Product family to which the construction product belongs**

Fire Stopping and Sealing Product:  
 • Linear Joint and Gap Seals

**Manufacturer**

Rudolf Hensel GmbH  
 Lack-und Farbenfabrik  
 Lauenburger Landstr. 11  
 21039 Börnsen  
 Germany

**Manufacturing plant(s)**

A/001

**This European Technical Assessment contains**

17 pages including 1 Annex which forms an integral part of this assessment.

**This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of**

EAD 350141-00-1106, September 2017.

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

## **Table of Contents**

<b>I.</b>	<b>SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT .....</b>	<b>3</b>
1	Technical description of the product .....	3
2	Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350141-00-1106, September 2017 .....	3
3	Performance of the product and references to the methods used for its assessment .....	5
4	ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE.....	6
5	Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD .....	6
6	Issued on:.....	7
<b>ANNEX A – Resistance to Fire Classification – Hensotherm Kitt .....</b>	<b>8</b>	
A.1	Rigid wall constructions with wall thickness of minimum 200 mm.....	8
A.1.1	Linear joint or gap seal, vertically oriented with sealant to the exposed face .....	8
A.1.2	Linear joint or gap seal, vertically oriented with sealant to both faces.....	9
A.2	Rigid wall constructions with wall thickness of minimum 150 mm.....	10
A.2.1	Linear joint or gap seal, vertically oriented with sealant to both faces.....	10
A.2.2	Linear joint or gap seal, horizontally oriented at the head of walls, with sealant to both faces .....	11
A.3	Flexible wall constructions up to 3m high, with wall thickness of minimum 100 mm .....	12
A.3.1	Linear joint or gap seal, vertically oriented with sealant to both faces.....	12
A.3.2	Linear joint or gap seal, horizontal linear joint seals, between the head of flexible walls minimum 100 mm thick and rigid floors .....	13
	Rigid wall constructions according to 1.2.1 with wall thickness of minimum 100 mm .....	14
A.3.3	Linear joint or gap seal, vertically oriented with sealant to the exposed face .....	14
A.4	Rigid floor constructions according to 1.2.1 with wall thickness of minimum 150 mm .....	15
A.4.1	Linear joint or gap seal, between floor slabs or between floor slab and wall with sealant to the top face of the floor only .	15
A.4.2	Linear joint or gap seal, between floor slabs or between floor slab and wall with sealant to both faces of the floor .....	16
A.5	Flexible wall constructions according to 1.2.1 with wall thickness of minimum 110 mm.....	17
A.5.1	Linear joint seal, between the top of the wall boards and the floor soffit, seal to both faces .....	17

## I. SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT

### 1 Technical description of the product

- 1) Hensotherm Kitt is a sealant used to form linear gap seals where gaps are present in wall and floor constructions and linear joint seals where wall and floor constructions abut.
- 2) The Hensotherm Kitt is supplied in liquid form contained within 310 ml cartridges, 600ml foils or in 5, 10, 15 or 19 litre tubs. The sealant is gunned or trowelled into the aperture in or between the separating element/elements and where appropriate around the service or services, to a specified depth utilising various backing materials.
- 3) The applicant has presented a declaration that the product and/or constituents of the product contains no substances which have been classified as dangerous according to Directive 67/548/EEC and Regulation (EC) No. 1272/2008 and listed in the 'indicative list on dangerous substances' of the EGDS – taking into account the installation conditions of the construction product and the release scenarios resulting from there.

In addition to the specific clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

- 4) The use category of Hensotherm Kitt in relation to BWR 3 (Health, hygiene and environment) is IA1.

### 2 Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350141-00-1106, September 2017

Detailed information and data is given in Annex A.

The intended use of system Hensotherm Kitt is to reinstate the fire resistance performance of gaps in and joints in and between flexible wall and rigid wall constructions, gaps in and joints between rigid floor constructions.

- 1) The specific elements of construction that the system Hensotherm Kitt may be used to provide a gap or joint seal in, are as follows:

Flexible walls:	The wall must have a minimum thickness of 100 mm and comprise steel studs lined on both faces with minimum 2 layers of 12.5 mm thick boards.
Rigid walls:	The wall must have a minimum thickness of 100 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 650 kg/m <sup>3</sup> .
Rigid floors:	The floor must have a minimum thickness of 150 mm and comprise aerated concrete or concrete with a minimum density of 650 kg/m <sup>3</sup> .

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

- 2) The system Hensotherm Kitt may be used to provide a linear joint or gap seal with specific supporting constructions and substrates (for details see Annex A).
- 3) The maximum permitted joint/gap width for system Hensotherm Kitt is 100 mm.
- 4) The maximum movement capability of system Hensotherm Kitt is  $\leq 7.5\%$

- 5) The provisions made in this European Technical Assessment are based on an assumed working life of the Hensotherm Kitt of 10 years, provided that the conditions laid down in the manufacturer's instructions and datasheet for the packaging/transport/ storage/installation/ use/repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.
- 6) Type Z<sub>1</sub>: Intended for use at internal conditions with high or other humidity classes, excluding temperatures below 0°C.

### 3 Performance of the product and references to the methods used for its assessment

Product-type: Sealant		Intended use: Linear Joint & Gap Seal
Basic requirement for construction work	Essential characteristic	Performance
<b>BWR 2 Safety in case of fire</b>		
EN 13501-1	Reaction to fire	Class F
EN 13501-2	Resistance to fire	Annex A
<b>BWR 3 Hygiene, health and environment</b>		
Declaration of manufacturer & EN 16516	Content, emission and/or release of dangerous substances	Use categories: IA1 Declaration of manufacturer
EN 1026:2000	Air permeability (material property)	No performance determined
EAD 350141-00-1106, Annex C & EN 12390-8	Water permeability (material property)	No performance determined
<b>BWR 4 Safety in use</b>		
EOTA TR 001:2003	Mechanical resistance and stability	No performance determined
EOTA TR 001:2003	Resistance to impact/movement	No performance determined
EOTA TR 001:2003 ISO 11600 & EAD 350141-00-1106, Clause 2.2.13	Adhesion	No performance determined
EAD 350141-00-1106, Clause 2.2.12	Durability	Z <sub>1</sub>
EAD 350141-00-1106, Clause 2.2.13	Movement capacity	No performance determined
EAD 350141-00-1106, Clause 2.2.14	Cycling of perimeter seals for curtain walls	No performance determined
EAD 350141-00-1106, Clause 2.2.15	Compression set	No performance determined
EAD 350141-00-1106, Clause 2.2.16	Linear expansion on setting	No performance determined
<b>BWR 5 Protection against noise</b>		
EN 10140-1,2,4,5/ EN ISO 717-1	Airborne sound insulation	No performance determined
<b>BWR 6 Energy economy and heat retention</b>		
EN 12664, EN 12667, EN 12939, EN ISO 8990, EN ISO 6946, EN ISO 10456	Thermal properties	No performance determined
EN ISO 12572, EN 12086, EN ISO 10456	Water vapour permeability	No performance determined

**4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE**

According to the decision 1999/454/EC – Commission Decision of date 22nd June 1999 on the procedure for attesting the conformity of construction products pursuant to Article 20(2) of Council Directive 89/106/EEC as regards fire stopping, fire sealing and fire protective products, published in the Official Journal of the European Union (OJEU) L178/52 of 14/07/1999, see <http://eur-lex.europa.eu/JOIndex.do> of the European Commission<sup>1</sup>, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table(s) applies (apply).

<b>Product(s)</b>	<b>Intended use(s)</b>	<b>Level(s) or class(es)</b>	<b>System(s)</b>
Fire stopping and Fire Sealing Products	For fire compartmentation and/or fire protection or fire performance	Any	1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD**

Tasks of the manufacturer:

Factory production control

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall ensure that the product is in conformity with this European technical Assessment.

The manufacturer may only use initial / raw / constituent materials stated in the technical documentation of this European Technical Assessment.

The factory production control shall be in accordance with the Control Plan of 18<sup>th</sup> April 2011 relating to the European technical assessment ETA 19/0749 issued on 20/11/2019 which is part of the technical documentation of this European technical approval. The "Control Plan" is laid down in the context of the factory production control system operated by the manufacturer and deposited at UL International (UK) Ltd.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the Control Plan.

---

<sup>1</sup> Official Journal of the European Communities L178/52 of 14/7/1999

Other tasks of the manufacturer

Additional information

The manufacturer shall provide a technical data sheet and an installation instruction with the following minimum information:

(a) Technical data sheet:

- Field of application:
- Building elements for which the linear joint seal is suitable, type and properties of the building elements like minimum thickness, density, and - in case of lightweight constructions – the construction requirements.
- Limits in size, minimum thickness etc. of the joint seal
- Construction of the linear joint seal or penetration seal including the necessary components and additional products (e.g. backfilling material) with clear indication whether they are generic or specific.

(b) Installation instruction:

- Steps to be followed
- Procedure in case of retrofitting
- Stipulations on maintenance, repair and replacement

**6 Issued on:**

**20<sup>th</sup> November 2019**

Report by:



D. Yates  
Project Engineer  
Building and Life Safety Technologies

Reviewed by:




C. Johnson  
Staff Engineer  
Building and Life Safety Technologies

**For and on behalf of UL International (UK) Ltd.**

## ANNEX A – Resistance to Fire Classification – Hensotherm Kitt

### A.1 Rigid wall constructions with wall thickness of minimum 200 mm


#### A.1.1 Linear joint or gap seal, vertically oriented with sealant to the exposed face

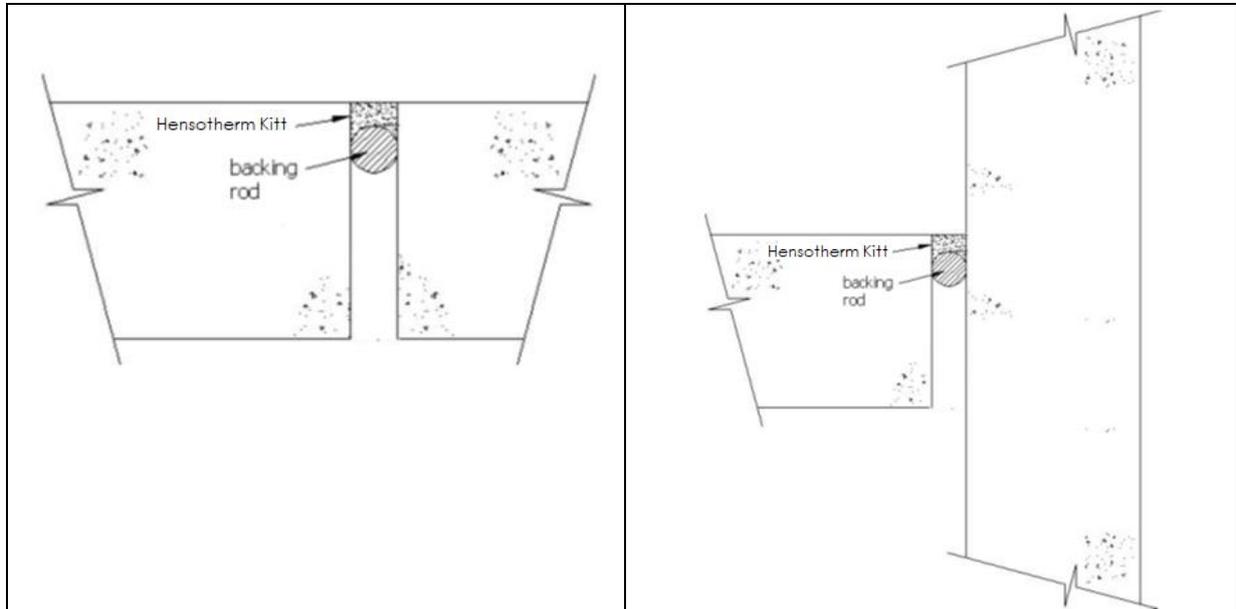

##### A.1.1.1

Hensotherm Kitt Linear Joint Seals in Rigid Walls 200 mm thick (min.) – Sealant on the Exposed/Fire Side of the Seal Only			
Substrate	Depth (mm)	Backing	Classification
Masonry/ concrete	25 min.	Polyethylene rod	E 240 – V – X – F – W 30 EI 60 – V – X – F – W 30
	20 min.		E 240 – V – X – F – W 20 EI 90 – V – X – F – W 20
	10 min.		E 240 – V – X – F – W 10 EI 180 – V – X – F – W 10

**A.1.2 Linear joint or gap seal, vertically oriented with sealant to both faces**

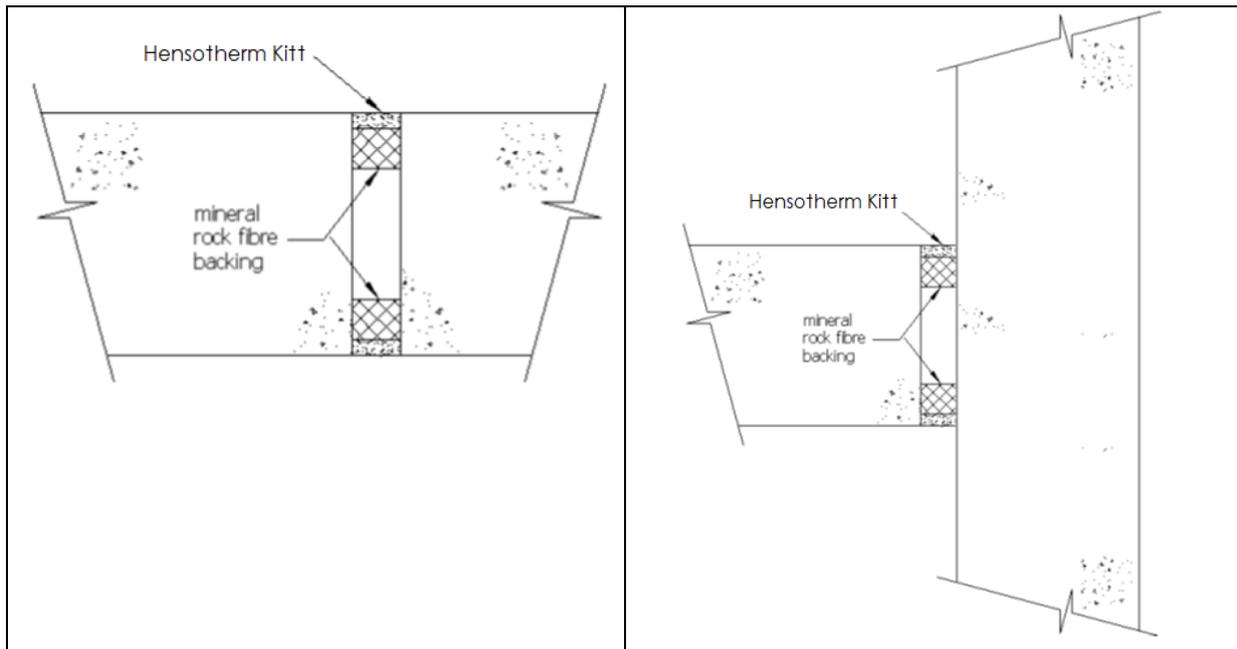


**A.1.2.1**

<b>Hensotherm Kitt Linear Joint Seals in Rigid Walls 200 mm thick (min.) – Sealant flush to both faces of the wall</b>			
<b>Substrate</b>	<b>Depth (mm)</b>	<b>Backing</b>	<b>Classification</b>
Masonry/ concrete	20 min.	Stone wool 20 deep / 90 kg/m <sup>3</sup>	<b>EI 240 – V – X – F – W 30</b>
	10 min.	Stone wool 10 deep / 90 kg/m <sup>3</sup>	<b>EI 240 – V – X – F – W 10</b>

## A.2 Rigid wall constructions with wall thickness of minimum 150 mm


### A.2.1 Linear joint or gap seal, vertically oriented with sealant to both faces

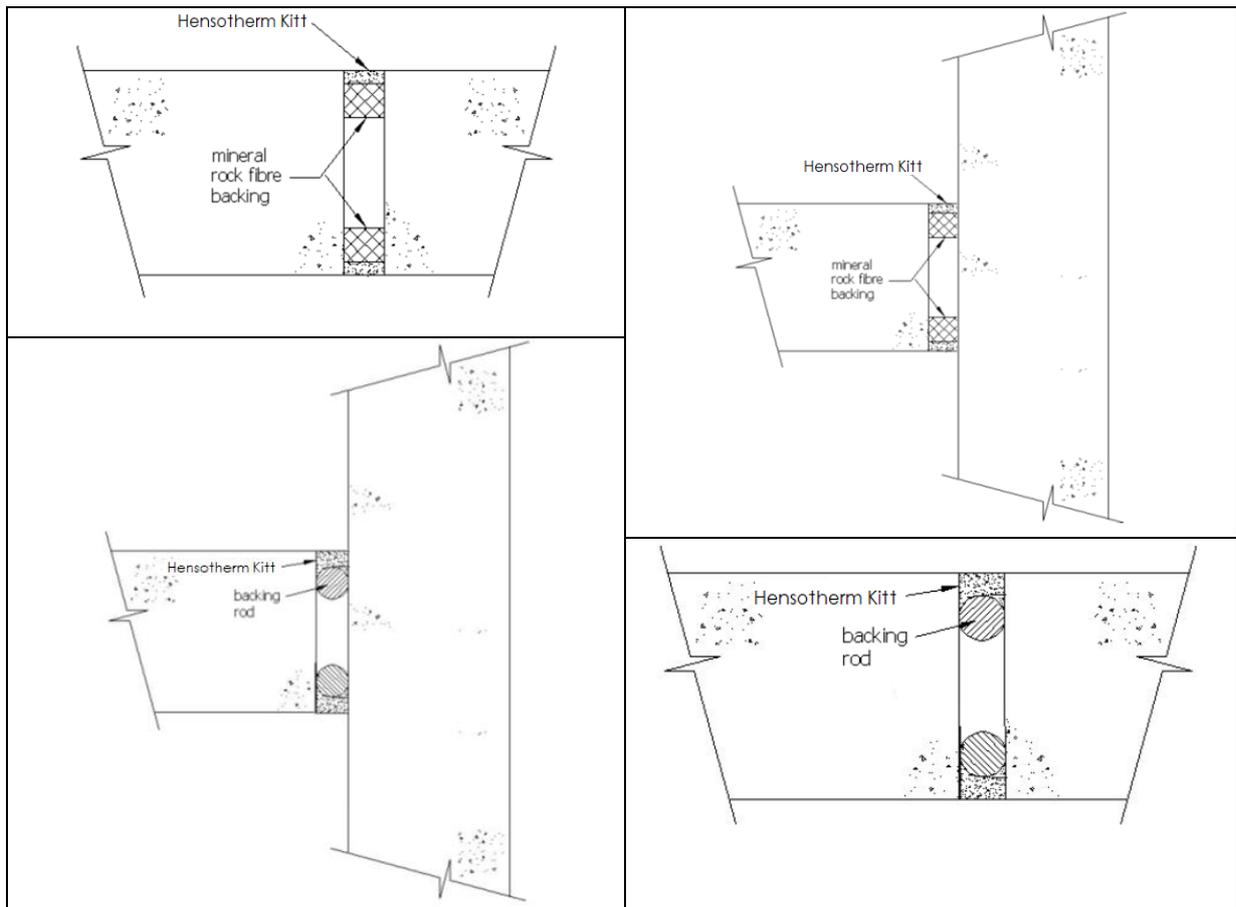

#### A.2.1.1

Hensotherm Kitt Linear Joint Seals in Rigid Walls 150 mm thick (min.) – Sealant flush to both faces of the wall			
Substrate	Depth (mm)	Backing	Classification
Masonry/ concrete	15 min.	Polyethylene rod	E 240 – V – X – F – W 30 EI 180 – V – X – F – W 30
	10 min.	Polyethylene rod	E 240 – V – X – F – W 20 EI 180 – V – X – F – W 20
Masonry/ concrete to steel	10 min.	Polyethylene rod	E 240 – V – X – F – W 30 EI 90 – V – X – F – W 30
	25 min.	50 mm Rockwool RW4 Stone wool	EI 240 – V – X – F – W 50
Masonry/ concrete to timber	20 min.	Polyethylene rod	EI 120 – V – X – F – W 30
	15 min.	Rockwool RW4 Stone wool, 120 mm deep min.	EI 180 – V – X – F – W 30
Timber/ Concrete	25 min.	50 mm Rockwool RW4 Stone wool	EI 120 – V – X – F – W 50

**A.2.2 Linear joint or gap seal, horizontally oriented at the head of walls, with sealant to both faces**

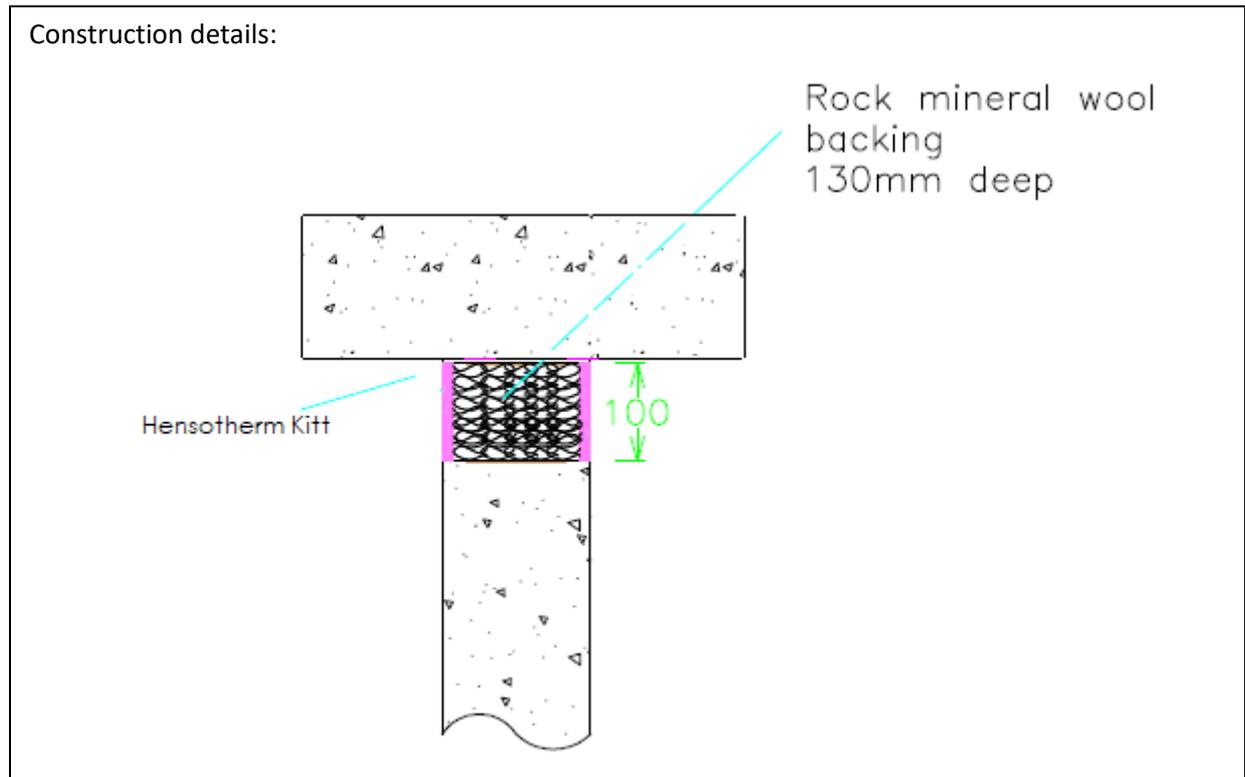


**A.2.2.1**

Substrate	Depth (mm)	Backing	Classification
Masonry/ Concrete	10 min.	130 mm Rockwool RW4 Stone wool	<b>EI 240 – T – X – F – W 100</b>

**A.3 Flexible wall constructions up to 3m high, with wall thickness of minimum 100 mm**


**A.3.1 Linear joint or gap seal, vertically oriented with sealant to both faces**

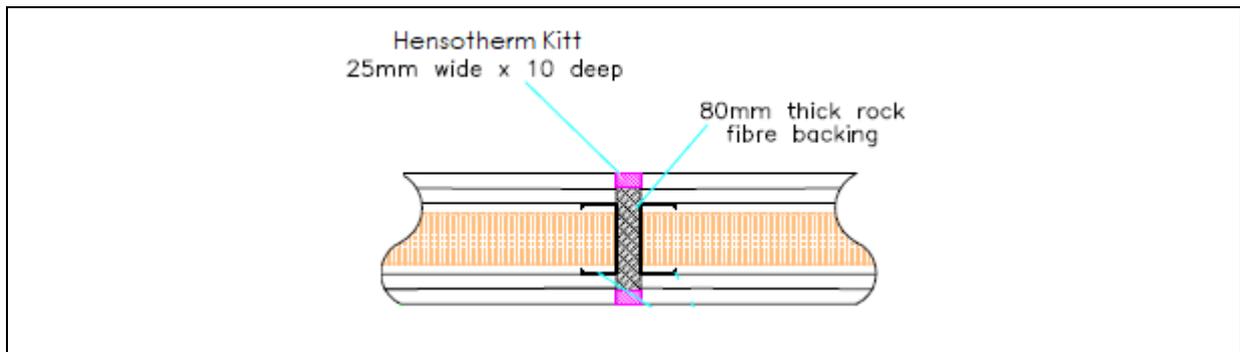

**A.3.1.2**

Substrate	Depth (mm)	Backing	Classification
Gypsum board / Gypsum board	10 min.	80 mm Rockwool RW4 Stone wool	<b>EI 120 – V – X – F – W 25</b>

**A.3.2 Linear joint or gap seal, horizontal linear joint seals, between the head of flexible walls minimum 100 mm thick and rigid floors**

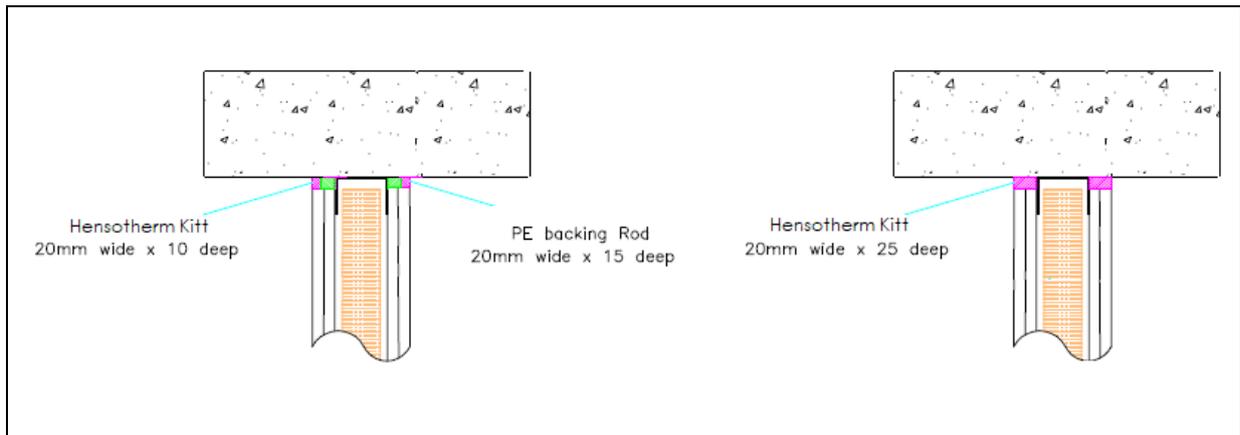


**A.3.2.1**

Substrate	Depth (mm)	Backing	Classification
plasterboard / Concrete	25 min.	50 mm steel head track	EI 120 – T – X – F – W 20
	10 min.	15 mm PE backer plus 50 mm steel head track	

**Rigid wall constructions according to 1.2.1 with wall thickness of minimum 100 mm**

**A.3.3 Linear joint or gap seal, vertically oriented with sealant to the exposed face**

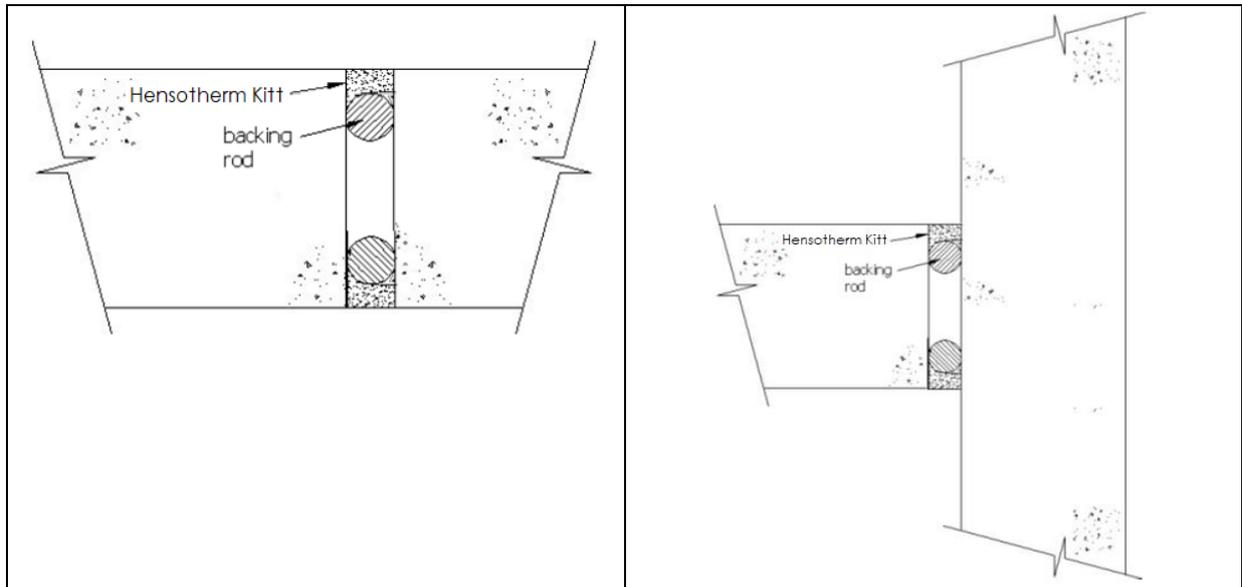


**A.3.3.1**

<b>Hensotherm Kitt Linear Joint Seals in Rigid Walls 100 mm thick (min.) – Sealant flush to both faces of the wall</b>			
<b>Substrate</b>	<b>Depth (mm)</b>	<b>Backing</b>	<b>Classification</b>
Masonry/ concrete	15 min.	Polyethylene rod	<b>E 240 – V – X – F – W 00 to 30</b> <b>EI 120 – V – X – F – W 00 to 30</b>

**A.4 Rigid floor constructions according to 1.2.1 with wall thickness of minimum 150 mm**


**A.4.1 Linear joint or gap seal, between floor slabs or between floor slab and wall with sealant to the top face of the floor only**

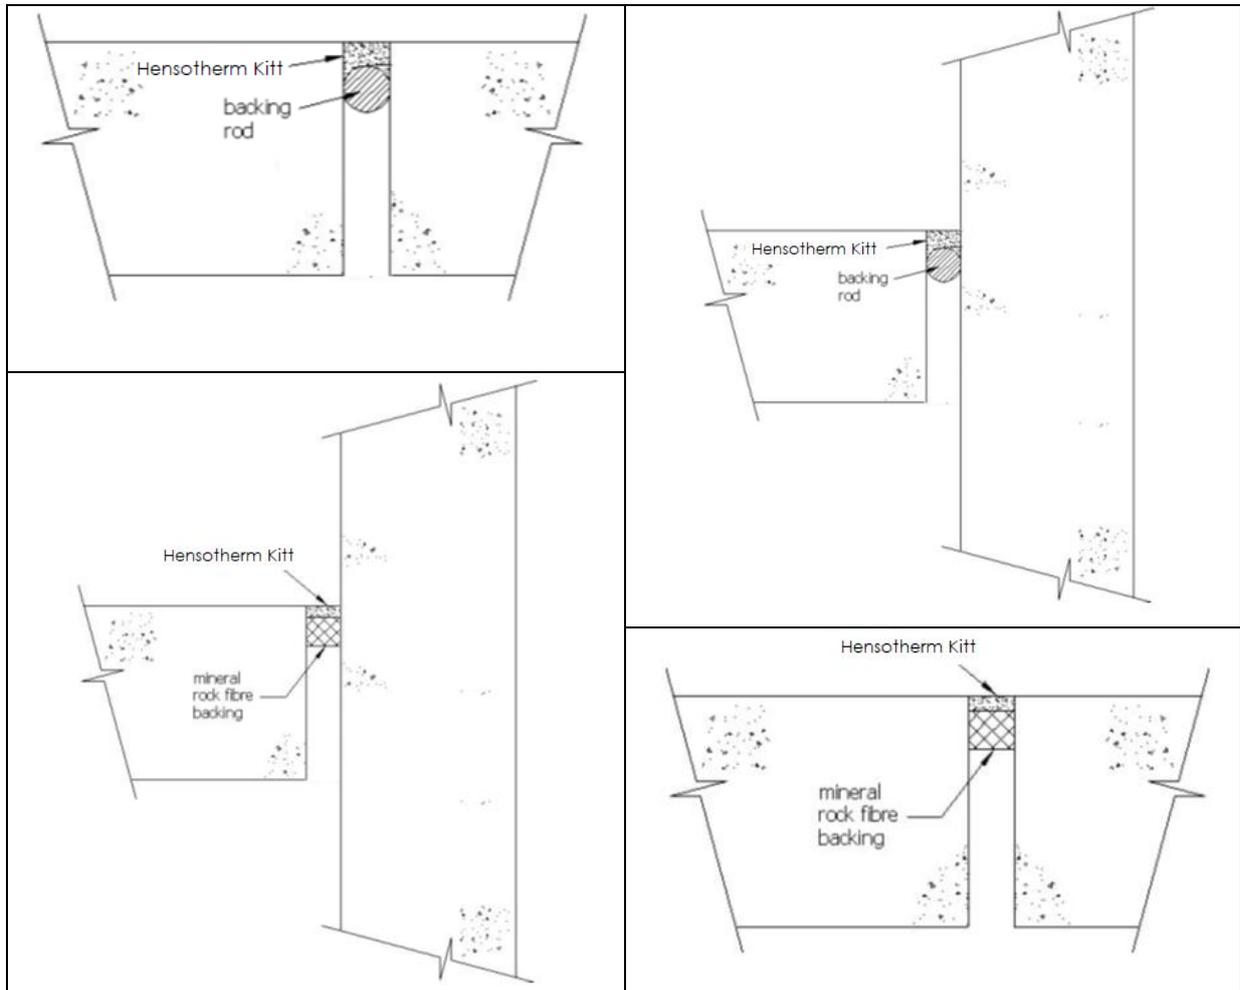

**A.4.1.1**

<b>Hensotherm Kitt Linear Joint Seals in Rigid Floors 150 mm thick (min.) – Sealant to the top of the floor only</b>			
<b>Substrate</b>	<b>Depth (mm)</b>	<b>Backing</b>	<b>Classification</b>
Masonry/ concrete	10 min.	Stone wool 90 kg/m <sup>3</sup> 25 mm deep min.	E 240 – H – X – F – W 00 to 30 EI 180 – H – X – F – W 00 to 30
	15 min.	Polyethylene rod	E 90 – H – X – F – W 00 to 30 EI 45 – H – X – F – W 00 to 30
	10 min.	Polyethylene rod	E 240 – H – X – F – W 00 to 20 EI 60 – H – X – F – W 00 to 20
	10 min.	Polyethylene rod	E 240 – H – X – F – W 00 to 10 EI 120 – H – X – F – W 00 to 10

**A.4.2 Linear joint or gap seal, between floor slabs or between floor slab and wall with sealant to both faces of the floor**

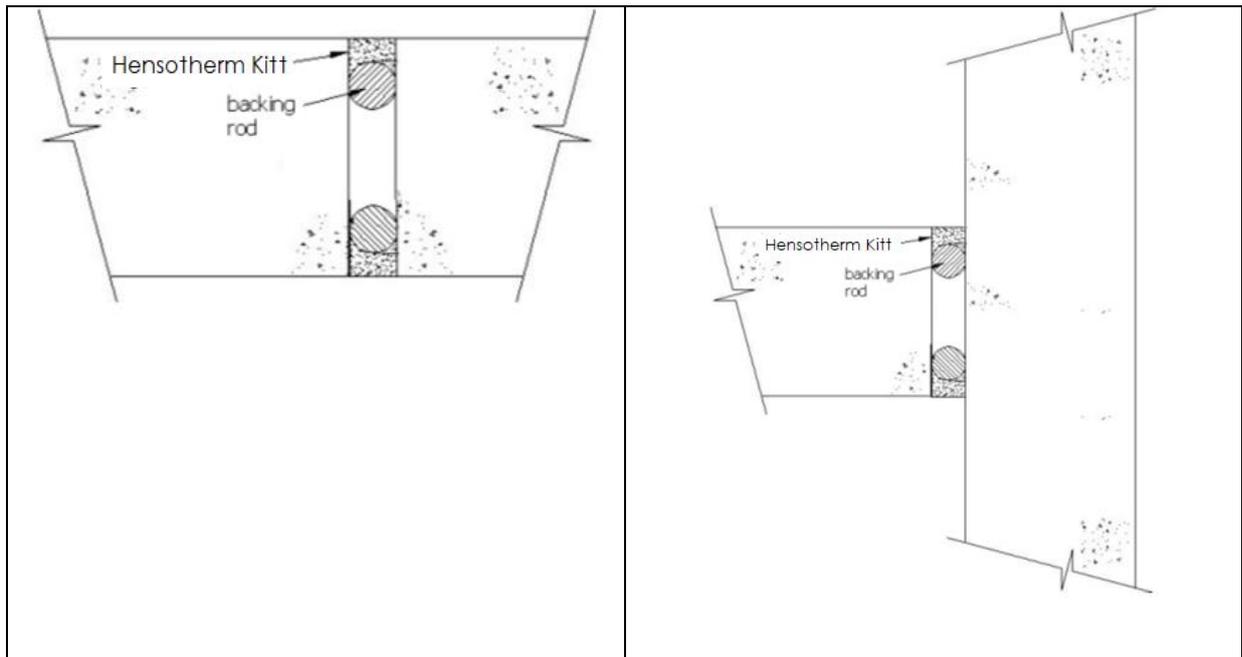


**A.4.2.1**

<b>Hensotherm Kitt Linear Joint Seals in Rigid Floors 150 mm thick (min.) – Sealant flush to both faces of the floor</b>			
<b>Substrate</b>	<b>Depth (mm)</b>	<b>Backing</b>	<b>Classification</b>
Masonry/ concrete	10 min.	Polyethylene rod	<b>E 240 – H – X – F – W 00 to 30</b> <b>EI 180 – H – X – F – W 00 to 30</b>
Masonry/ concrete to steel	10 min.	Polyethylene rod	<b>E 240 – H – X – F – W 00 to 30</b> <b>EI 90 – H – X – F – W 00 to 30</b>

**A.5 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 110 mm**

**A.5.1 Linear joint seal, between the top of the wall boards and the floor soffit, seal to both faces**

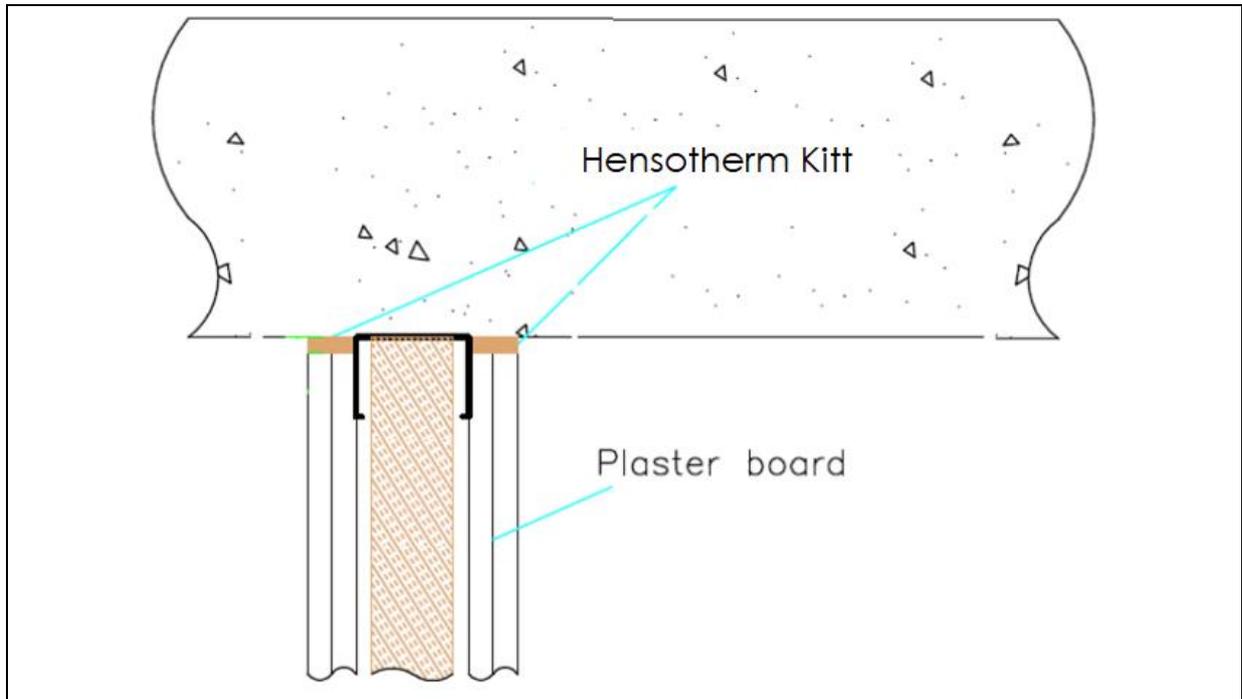

**A.5.1.1**

<b>Hensotherm Kitt Linear Joint Seals at the head of Flexible Walls 110 mm thick (min.) – Sealant flush to both faces of the wall</b>			
<b>Substrate</b>	<b>Depth (mm)</b>	<b>Backing</b>	<b>Classification</b>
Masonry/ Concrete to gypsum board	30 min.	50 mm (min.) steel head track infilled with 50 mm stone wool	<b>EI 120 – T – X – F – W 00 to 10</b>